

TEST REPORT

No. : XMIN190100111CCM

Date : Jan.22, 2019

Page: 1 of 2

Sample Name : L'FLOOR CARPET WHITE
Material : PVC COATED POLYESTER WOVEN FABRIC
Spec : 85% PVC AND 15 POLYESTER

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

Test Required : Selected test(s) as requested by applicant
Date of Receipt : Jan.16, 2019
Testing Start Date : Jan.16, 2019
Testing End Date : Jan.22, 2019
Test Result(s) : For further details, please refer to the following page(s)
(Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

***** To be continued*****

Signed for
SGS-CSTC Standards Technical
Services Co., Ltd. Xiamen Branch
Testing Center



Civi Huang Authorized Signatory

TEST REPORT

No. : XMIN190100111CCM

Date : Jan.22, 2019

Page: 2 of 2

Slip resistance (oil-wet ramp test)

Test Method:

DIN 51130:2014-02 Testing of floor coverings - Determination of the anti-slip property - Workrooms and fields of activities with slip danger, walking method - Ramp test

Sample Description:

Floor, 1300mm×700mm, 1pc, see the photo(s)

Test Result:


Testing direction & testing surface: see the photo(s)

Test item(s)	Test result(s)	Classification
Slip resistance (oil-wet ramp test)	Critical angle of inclination: 7.8°	R9

Classification of oil-wet ramp test:

Classification	Angle (degrees)
R9	$6^{\circ} \leq X \leq 10^{\circ}$
R10	$10^{\circ} < X \leq 19^{\circ}$
R11	$19^{\circ} < X \leq 27^{\circ}$
R12	$27^{\circ} < X \leq 35^{\circ}$
R13	$> 35^{\circ}$

Specimen photograph(s):

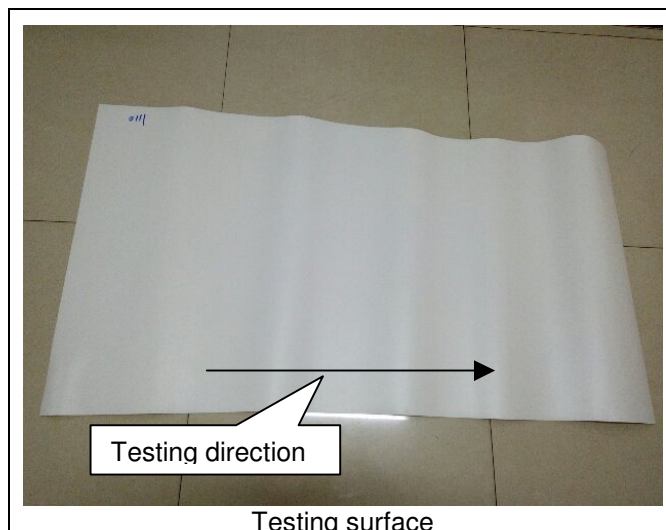

SGS authenticate the photo(s) on original report only

*****End of report*****